

Consumption temporary density for the detection of water leakages in real-time

Anissa Ticherahine, Soumia Bourebia, Abdenacer Makhoul, Patrice Wira

University of Haute Alsace, IRIMAS, Mulhouse, France

Email: anissa.ticherahine@uha.fr, soumia.bouerbria@uha.fr,

abdenacer.makhoul@uha.fr, patrice.wira@uha.fr

Abstract—Detecting water leakage is a major challenge. Usually, specific meters are used to monitor water consumption. However, conventional meters are not capable of detecting an abnormal consumption such as an eventual leak. Due to the recent advances in technologies and the emergence of the Internet of Things paradigm, a new kind of smart water meter has appeared. These meters provide further options for monitoring water consumption. In this paper, a new water leakage indicator called Water Leakage Indicator based on the Consumption Temporary Density (WLICTD) is presented. The leakage detection process is based on a computation of temporal density for water consumption. WLICTD can distinguish an abnormal consumption, i.e., a leak situation, from a normal daily consumption. The proposed indicator has been evaluated using a set of real water consumption data obtained from a smart meter installed in a university restaurant in France. Results reveal the strength of the proposed indicator, all water leaks situations are detected within a convenient period that allows a reduced timing for proper fixing operations.

Index Terms—Water leakage detection, intelligent meter, IoT, temporary density.

I. INTRODUCTION

A water leak is an event that tends to happen in unexpected times. The most important thing is to be able to fix it quickly enough in order to both limit the damage and to minimize the repairing costs as well. In the majority of cases, leaks are not detected early enough when the damage is minor or under normal consumptions. The emergence of the Internet of Things (IoT) paradigm has open new perspectives in several fields [1], [2]. Since these recent years, enhanced sensors have been developed. They are able to measure with a high precision the consumption and to transmit the data several time a day. They may be used in order to detect the leaks. Water Distribution Networks (WDN) are characterized by numerous nodes and a high number of branches. Identifying the vanishing pipes is therefore a very difficult task. Moreover, a constant, small and diffuse flow cannot be detected by conventional measuring instruments especially since the consumption data are generally only recorded and transmitted over a long period of time. This can lead to great losses of water [3]. In Europe, 11% of the European population and 17% of its territory has been affected by water scarcity according to the European Commission's estimate [4]. The importance of detecting leaks consists in preserving water resources, avoiding consequential damages in the WDN and saving water demand. In addition, a water leakage can affect the water quality by introducing infections

into the WDN and have important consequences on the health and safety of the population [5].

We aim in this paper to provide a new water leakage indicator based on the consumption temporary density.

This article is organized as follows: Section II examines the state of the art on water leak detection. Section III describes the platform that is used to collect the data on the web, describes the raw water consumption data and introduces the daily load curves generally used to monitor water consumptions. In Section IV, we propose a Water Leakage Indicator based on the Consumption Temporary Density (WLICTD) which is based on a temporary density for detecting water leakages. In Section V, the proposed approach is validated with experimental examples of water leaks in a university restaurant and compared the existing approaches.

II. RELATED WORKS

The IoT [6] is an enlargement of the Internet's architecture and consists in a full integration of connected devices. These devices can be Cyber-Physical Systems (CPS) that communicate with each other but also with the servers and the users [7]. The IoT concept aims to make the information system architecture important for the implementation of intelligent buildings in a more widespread way [8]. IoT water meters can immediately record and transmit pulses or events that correspond to the small amount of water consumed in a few period of time like minutes or seconds. Thus, measured consumption are collected and stored on a data center from where they are available to be analyzed. Therefore, it is possible to use the data measured during these small time stamps or intervals to detect the leaks.

A load profile is the key concept to analyze consumption and to separate the normal consumption from water leaks and other abnormal water needs. A load profile is the variation of water load with time. In a WDN, a load profile represents the amount of water that flows through a measurement point. Therefore, the area under the load curve gives the total units of water generated or consumed. In addition, the cumulative load curve represents the evolution of the index over a specific time. The load profile is thus the derivative of the cumulative load curve over the same period. As the water consumption never remains constant rather it varies time to time and these variations in load can be plotted on half hourly or hourly basis or even every minutes for the whole day. The curve thus obtained is known

as daily cumulative load curve but it can also be extended for any period of time, i.e., it can be drawn for a month or for a year too. It can be seen that the load profile or the cumulative load curve are simple and efficient tools to evaluate the water use and demand, but also the efficiency and reliability of water transportation.

In the context of measuring water, a lot of different principles and algorithms have been proposed in various research works for purposes like estimating the quantity of wasted water, leaks detection and control, monitor the user consumption, reduce the time required to repair the leak, etc. The authors of [5] defined a Minimum Night Flow (MNF) that consists in a threshold defined for an isolated area where the demand of water is generally low. In [9], a method based on a Fuzzy Logic Decision Maker (FLDM) has been proposed to detect the leaks. It is based on a technique that relies on fuzzy sets to provide a kind of rough model of the WDN that takes into account its typology (material, length, diameter and age of pipes), environment (demand, topography and operating pressures) and even its operating conditions (population size, housing and socio-economic characteristics, living standards). Techniques based on the sensor fusion of data have been used in [4], [10]. However, they are not efficient to detect all the leaks. The approach proposed in [11] detects the leaks by being based on the learning of artificial neural networks but this approach needs a large data set. The work in [12] associates a MNF threshold with another threshold that is a Period Without Null Consumption (PWNC). It is able to detect most of the small water leaks during the day by using the water flow circulating in a measurement point. In addition, the detection of large leaks it based on the maximum load curve. This complete approach is based on data sampled every minutes.

In this article, we propose a leak detection algorithm that is based on the temporarily density of water consumption. This new approach takes into account the water consumption in a temporal manner by using real-time water consumption data. The data are collected and analyzed iteratively every minutes, this allows to detect the leaks in a period of only some hours.

III. DATA COLLECTION

The contribution of this paper is the development of an indicator able of detecting water leakages in a WDN. For this aim, we use a data set that consists in daily water consumption recorded in a university restaurant. This section first provides a detailed description of the platform used to generate the data. Then, the acquired data are explained.

A. Data capture platform

The model of the WDN and the principle of the recording platform installed in a university restaurant is depicted by Figure 1. The water consumption is monitored by a single smart meter. This water meter is a connected object with enhanced communication capabilities, i.e., that allows the measurement and transmission of the information about water consumption. More specifically, this meter allows the detection

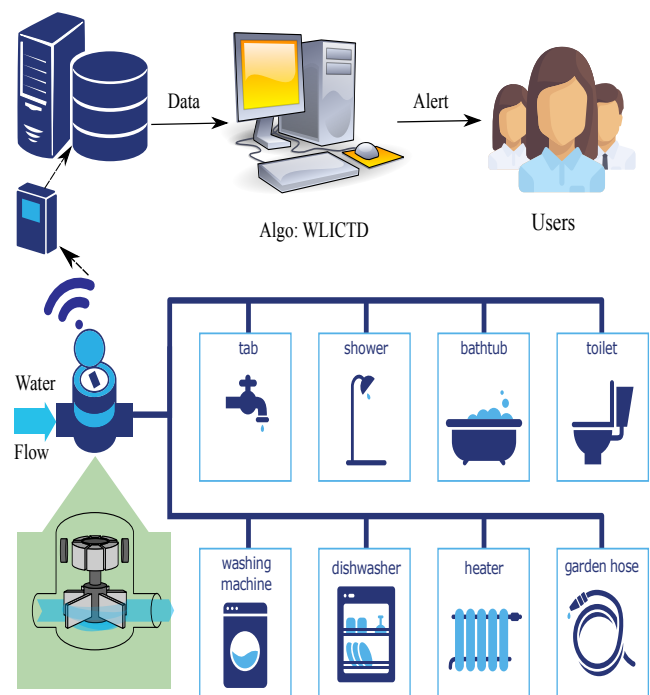


Fig. 1. The IoT platform in an integrated building [12] and [13]

of a pulse which represents one full rotation of the small turbine that is inside the water meter. Each time a liter of water is consumed, the turbine completes a rotation and thus generates an event (or a pulse). The produced data consists in stamping the event in time and sending it immediately to a remote storage server. This allows a real-time daily monitoring and control of the water consumption in the WDN.

B. Data description

As explained in the previous section, we use the data generated by a smart meter to detect water leakage. These data correspond to time lapses in milliseconds: $\Delta t_i = t_{i+1} - t_i$, such as for each $\Delta t_i, \forall i \in I$, a liter of water is consumed. One can note that:

- I is the number of data;
- t_i is the current time;

The evolution of the water consumption at the university restaurant is depicted by Figure 2 for the period from January 17th, 2018 to July 17th, 2018. The red points on Fig. 2. a) correspond to the pulses which indicate the consumption of one liter of water at each time lapse. The blank between red points stands for weekend and holiday periods. The curve on Fig. 2. b) which is represented in blue depicts the accumulated consumption over time.

Based on the data presented above, it is possible to produce the load curves. Daily load curves can be viewed as progressive curves that represent the real cumulated water consumption at precise instants of a day. These curves facilitate the water consumption analysis. A load curve always begins with a zero value, $C(t_0) = C(0) = 0$. At any given instant t_i ,

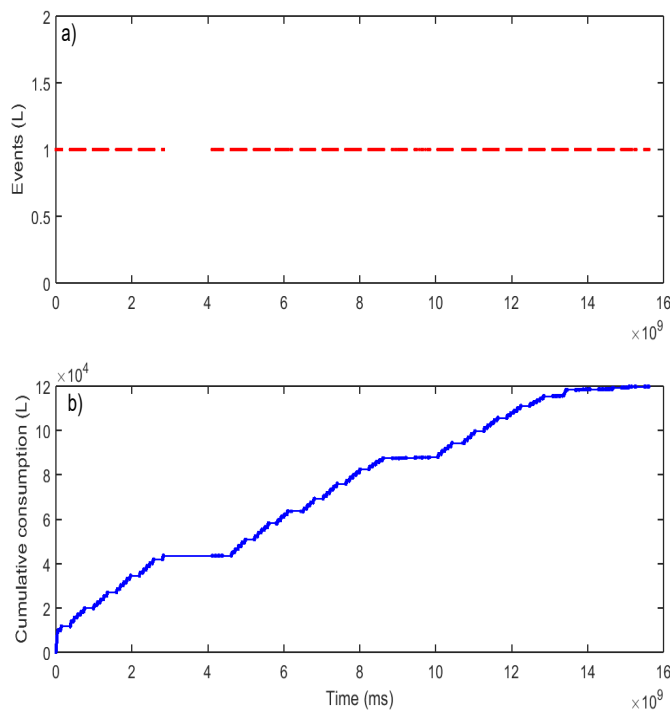


Fig. 2. Raw data of restaurant's water conception from January 17th, 2018 to July 17th, 2018

the curve is given by $C(t_i) = C(t_{i-1}) + 1$, since for every time gap $\Delta t_i = t_i - t_{i-1}$ a liter of water is consumed. The last value of the load curve corresponds to total water consumption of the day. Figure 3 illustrates several daily load curves. A preliminary observation shows that the behavior of the load curves changes from one day to another, i.e., the water consumption is not stable and is different from one day to another. However, the black load curves on Figure 3 show some similarities. It is very difficult to find a precise model that is able to represent all of them. The remaining colored curves are special curves that illustrate abnormal days (with leakage situations). The red curve represents the beginning of a leak at the end of January 17th, 2018. This leak was not detected and it continues until the following day, i.e., January 18th, 2018 (represented by the blue curve) until it was detected that mid-day. The second leak started on June 21th, 2018 and was detected on June 22th, 2018. It is depicted by the curves respectively in pink and green. In this paper, we aim to detect these leaks as early as possible for allowing a faster intervention and reducing potential damages.

IV. WATER LEAKAGE INDICATOR BASED ON CONSUMPTION TEMPORARY DENSITY

In order to detect water leakages, we propose to compute the temporal density of the water consumption. This density was used in [14] and [15] to analyze and measure the progress of random events over time. For each instance t_i , the temporal density $D(t_i)$ is computed and defined by:

$$D(t_i) = \lambda^{t_i - t_{i-1}} D(t_{i-1}) + 1 \quad (1)$$

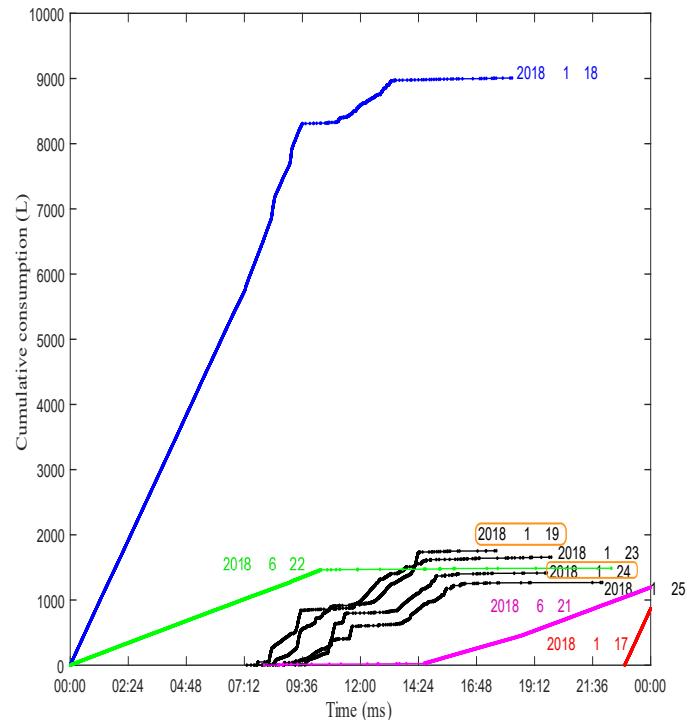


Fig. 3. Example of daily load curves of water consumption.

In (1), t_i stands for the current time and t_{i-1} represents the latest time of the density update D . $\lambda \in]0, 1[$ is a parameter named the fading factor which reflects the rate in which the density decreases with time. The value of λ is adjusted through empirical tests with respect to the constraint of minimizing the water leak detection time. D_{t_i} is thus the density at time t_i . Using this function, it is possible to measure the quantity (number) of water that has been consumed over a period of time. The density D is computed in an incremental way. Upon the consumption of one liter of water at the instant t_{i+1} , the density is updated by adding one liter of water to the old density attenuated in time. It is important to mention that at the instant t_0 that corresponds to the instant of the initialization of the density, the density D_0 is null, since there is no consumption at the beginning of the day $D(t_0) = D(0) = 0$. As this function depends on the time elapsed between the time of the last density update and the current time, it gives a global view of the water consumption profile. Thus, if the water consumption is regular, the density is low, whereas if the consumption is abnormal, the density is high.

Algorithm 1 WLICTD (Water Leakage Indicator Consumption Temporary Density)

```

Compute the temporal density  $D(t_i)$  at the instant  $t_i$ 
if  $D(t_i) \neq 1$  then
    if  $\Delta t_i > threshold$  then
        Leak detection
    end if
end if
    
```

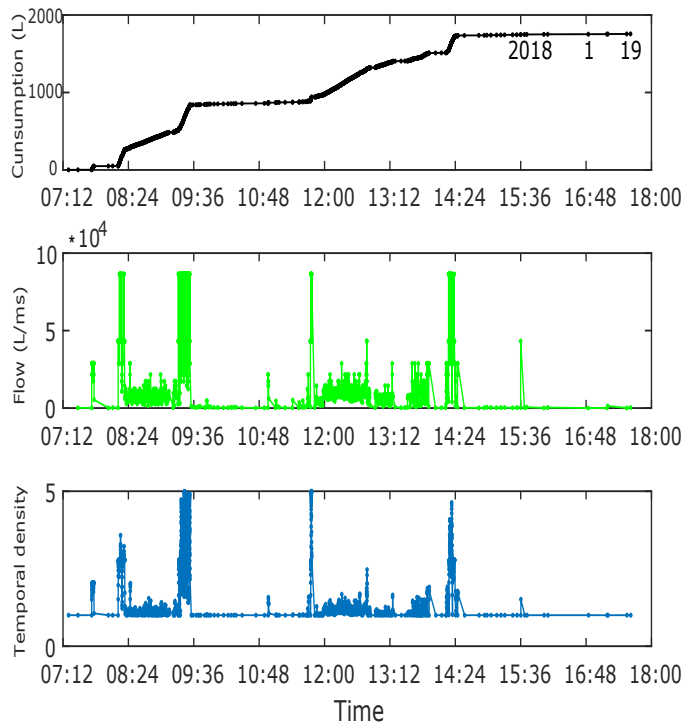


Fig. 4. The temporal density of water consumption during a typical day with $\lambda = 0.5$ and its load curve.

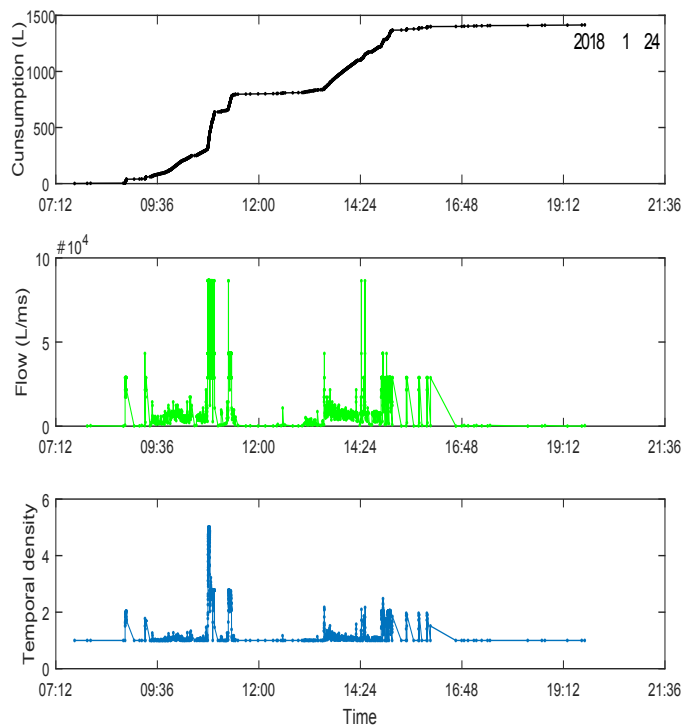


Fig. 5. The temporal density of water consumption during a typical day with $\lambda = 0.5$ and its load curve on 24/01/2018.

Figure 4 and 5 depicts examples of the temporal density evolution for water consumption during a normal day (i.e. a day without water leakage). We can observe that a high consumption implies a density greater than 1 since a big consumption implies a successive and rapid consumption which means that time gaps between the consumption of each liter are small, and as $\lambda \in]0, 1[$ this implies that $\lambda^{t_i - t_{i-1}} > 0$ which means $D(t_i) > 1$; $i > 1$. Whereas if the time gaps are large (which means there is a slow consumption) then $\lambda^{t_i - t_{i-1}} = \exp((t_i - t_{i-1}) \ln \lambda)$ approaches towards zero thus the density equals 1. According to the density computation for every day with $\lambda = 0.5$ a threshold has been defined by the maximum of the time deviations during periods of consequent consumption:

$$threshold = \max_i (\Delta^*(t_i)) = \max_i (t_{k_i} - t_{L_i}) \quad (2)$$

where $D(t_{k_i}) = D(t_{L_i}) = 1$ and $\forall j \in]k_i, L_i[, D(t_j) \neq 1$. Since the data consists of time gaps Δt_i so in order to detect the leaks, the temporal density is instantaneously calculated using $D(t_i) = \lambda^{\Delta t_i} D(t_{i-1}) + 1$; $D(t_0) = 0$. Then this value is compared with the value 1 and if $D(t_i)$ is different from 1 then we compare the difference in time with the threshold. If Δt_i is higher than the threshold then we have a water leak. This is illustrated by algorithm 1.

V. APPLICATIONS AND COMPARISON

A. Applications

Now we aim to apply the previous algorithm to our data set in the university restaurant.

Thanks to the WLICTD algorithm, we succeeded to detect all water leaks within a period of approximately 3 hours. Figure 6 illustrates the temporal density versus time in seconds for two abnormal days (January 17th, 2018 and January 18th, 2018). Our approach allows us to detect this leak within a period of 3 hours 11 minutes 13 seconds. Figure 7 depicts the temporal density versus time in seconds in two abnormal days on June 21th, 2018 and June 22th, 2018 respectively. Using our approach, this leak was detected within 3 hours 11 minutes 09 seconds.

The choice of the parameter involved in computation the temporal density λ is a very important task, for example for our data the value $\lambda = 0.1$ does not allow to detect the water leak since the temporal density is equal to 1 for all the differences of time. In addition, the value $\lambda = 0.99$ makes it possible to detect the water leak after 14 h 33 min 09 s. So, the detection time is very long. It turns out that the values of λ between 0.4 and 0.9 provide good results. One needs to do more experiments to fix a "universal" λ value or use deep learning and artificial intelligence to fix it in different situations.

B. Comparison between methods

Detecting water leaks by classical methods takes a long time. The use of the maximum curve [6] to detect water leaks is reliable in periods when there is no consumption like

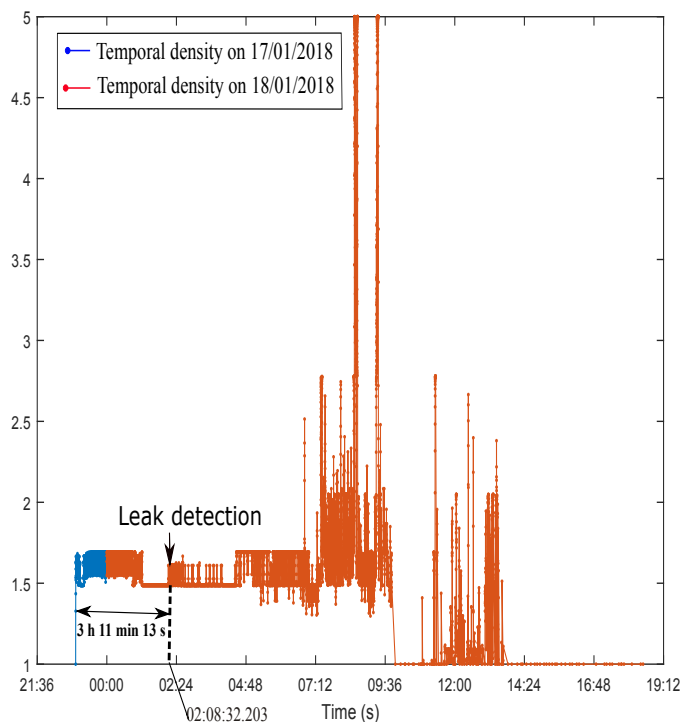


Fig. 6. The temporal density of water consumption during a day.

nights in the university restaurant. Similarly, we can use the Minimum Night Flow to detect leaks at night see [5] and [6]. With data sampled per hour, we calculate the MNF which is equal to the maximum number of liters of water consumed overnight during normal days. The night at the university restaurant must start at 7:00 p.m. when the university is closed and end at 6:00 a.m. (opening of the university). Moreover the MNF is fixed by 37 (L/h).

In any case the WLICTD algorithm detects the two leaks in 3 h 11 min as expected.

Now considering the maximum curve approach detects the leak of June 21, 2018 after 9 hours 22 minutes and the leak of January 17th, 2018 the next day in a period of one hour and 34 minutes this is due to starting of the leak which happened in the night corresponding to a period without any consumption in a normal situation. It turns out that the MNF is very efficient at night. Since it detects the leak of January 17th, 2018 after 5 minutes. The second leak which started at 14:38 during the day is detected when the night period started which correspond to 3 hours and 22 minutes see Figure 8.

We claim that the new approach based on the consumption temporary density is very efficient during the day, in general during a period of substantial consumption, comparing to the existing ones. The MNF approach is still the best one for the night periods. Therefore in order to improve detection of water leaks, we suggest a mix of the WLICTD and MNF methods, WLICTD will be applied during the day or period with substantial consumption and MNF used at night or period with no consumption as weekends.

Our approach is applicable on working days but for weekend

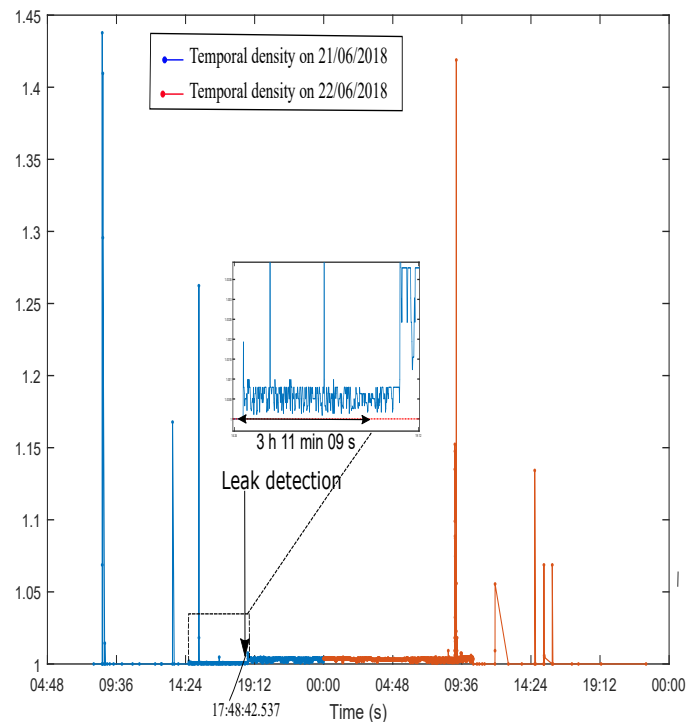


Fig. 7. The temporal density of water consumption during a day.

days it does not work because WLICTD is based on the temporal density which depends on the time data but in normal weekend days there is no consumption in the university restaurant. So to detect water leaks on weekends, we defined a threshold representing the maximum consumption on normal weekends which is equal to 3 liters of water in the university restaurant.

The Figure 9 explains the weekend water leak detection, based on a threshold shown in red, and the blue curve represents the load curve on March 24th, 2018.

VI. CONCLUSION

In this article, we have proposed a new approach for detecting water leakages. The detection process relies on the computation of a temporal density for water consumption. This density provides a reliable description of users' behavior in time, i.e., a water consumption profile over time which allows the recognition of abnormal activities such as high water consumption or water leakage. Our approach is named *WLICTD* for Water Leakage Indicator based on Consumption Temporary Density, and is able of detecting water leaks in approximately 3 hours. This approach allows to reduce the fixing time and thus to minimize the potential damages caused by the leak. It turns out that algorithm *WLICTD* is very efficient during periods of substantial consumptions comparing to other approaches. It is used to detect water leaks at a university restaurant during the day and the MNF approach seems to be still the best for night period. Looking ahead, we intend to investigate the performance of our indicator

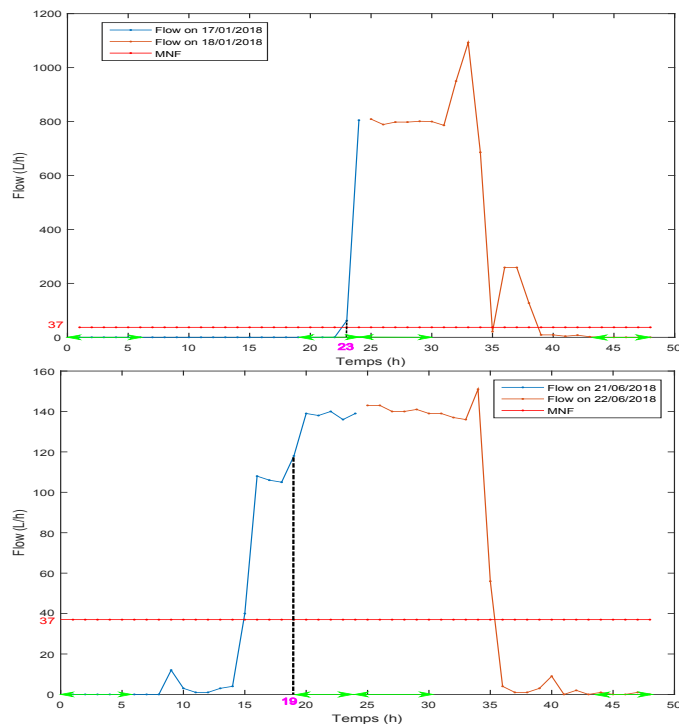


Fig. 8. Detecting a water leak by MNF.

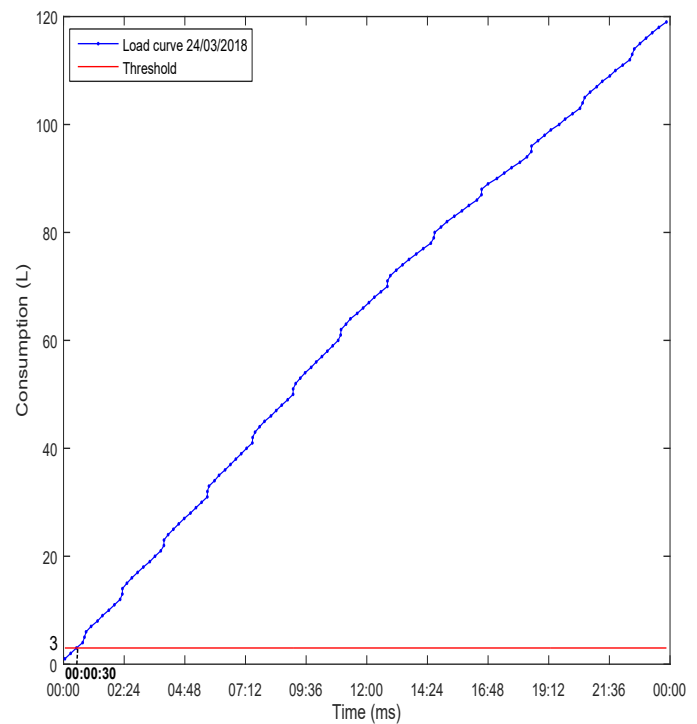


Fig. 9. Detecting a water leak in a weekend day.

in complex environments such as smart homes where users behavior is highly variable and fluctuating.

VII. ACKNOWLEDGMENT

The authors would like to thank the Centre Regional for Universitaires et Scolaires (CROUS), the regional center for student affairs, for providing access to the data that have been collected from the university restaurant and necessary in this study.

REFERENCES

- [1] S. Dey, A. Roy, and S. Das, "Home automation using internet of thing," in *2016 IEEE 7th Annual Ubiquitous Computing, Electronics & Mobile Communication Conference (UEMCON)*. IEEE, 2016, pp. 1–6.
- [2] H. Suo, J. Wan, C. Zou, and J. Liu, "Security in the internet of things: a review," in *2012 international conference on computer science and electronics engineering*, vol. 3. IEEE, 2012, pp. 648–651.
- [3] K. B. Adediji, Y. Hamam, B. T. Abe, and A. M. Abu-Mahfouz, "Leakage detection and estimation algorithm for loss reduction in water piping networks," *Water*, vol. 9, no. 10, p. 773, 2017.
- [4] B. Farley, S. Mounce, and J. Boxall, "Field testing of an optimal sensor placement methodology for event detection in an urban water distribution network," *Urban Water Journal*, vol. 7, no. 6, pp. 345–356, 2010.
- [5] R. Puust, Z. Kapelan, D. Savic, and T. Koppel, "A review of methods for leakage management in pipe networks," *Urban Water Journal*, vol. 7, no. 1, pp. 25–45, 2010.
- [6] A. Boudhaouia and P. Wira, "Power and water consumption monitoring with IoT devices and machine learning methods in a smart building." Presses universitaires de Strasbourg, vol. 346.
- [7] I. Szilagyi and P. Wira, "Ontologies and semantic web for the internet of things-a survey," in *IECON 2016-42nd Annual Conference of the IEEE Industrial Electronics Society*. IEEE, 2016, pp. 6949–6954.
- [8] S. D. T. Kelly, N. K. Suryadevara, and S. C. Mukhopadhyay, "Towards the implementation of iot for environmental condition monitoring in homes," *IEEE sensors journal*, vol. 13, no. 10, pp. 3846–3853, 2013.
- [9] R. Mamlook and O. Al-Jayyousi, "Fuzzy sets analysis for leak detection in infrastructure systems: a proposed methodology," *Clean technologies and environmental policy*, vol. 6, no. 1, pp. 26–31, 2003.
- [10] S. R. Mounce, A. Khan, A. S. Wood, A. J. Day, P. D. Widdop, and J. Machell, "Sensor-fusion of hydraulic data for burst detection and location in a treated water distribution system," *Information Fusion*, vol. 4, no. 3, pp. 217–229, 2003.
- [11] S. R. Mounce and J. Machell, "Burst detection using hydraulic data from water distribution systems with artificial neural networks," *Urban Water Journal*, vol. 3, no. 1, pp. 21–31, 2006.
- [12] A. Boudhaouia and P. Wira, "Water consumption analysis for real-time leakage detection in the context of a smart tertiary building," in *2018 International Conference on 12 Applied Smart Systems (ICASS)*. IEEE, 2018, pp. 1–6.
- [13] P. Wira, "Energy management and consumption analysis with machine learning techniques," *IWOLIAI*, vol. 13, no. 10.
- [14] G. Roudiere and P. Owezarski, "A lightweight snapshot-based DDoS detector," in *2017 13th International Conference on Network and Service Management (CNSM)*. IEEE, pp. 1–7.
- [15] S. Bourebia, H. Laghmara, B. Hilt, F. Drouhin, S. Bindel, J. Ledy, J.-P. Lauffenburger, and P. Lorenz, "A belief function-based forecasting link breakage indicator for vanets," *Wireless Networks*, pp. 1–16, 2019.